

# ECODESIGN & ENERGY LABELLING INFORMATION

Samsung Gen 5 air to water Heat Pump  
5kW monobloc



Rev 01  
Joule Energy Solutions

## **I. Abstract**

Welcome to the Ecodesign and Energy labelling directive guide for the Samsung Gen 5 monobloc 5kW air to water heat pump - by Joule Energy Solutions. The purpose of this document is to fulfil the requirements of the directive Eu No. 813/2013. The directive ensures the correct product information is available to BER assessors, Engineers and specifiers alike. The information within this guide is fully compliant with the directive and provides everything needed to fulfil the SEAI requirements for DEAP methodology.

## II. Table of Contents

<b>1. INTRODUCTION .....</b>	<b>1</b>
<b>2. PRODUCT INFORMATION .....</b>	<b>2</b>
2.1. INSTRUCTION MANUALS .....	2
2.2. TECHNICAL PARAMETERS .....	3
2.2.1. <i>Low temperature application</i> .....	3
2.2.2. <i>Medium temperature application</i> .....	4
<b>3. PRODUCT LABELS.....</b>	<b>5</b>
3.1. HEAT PUMP SPACE HEATER.....	6
3.2. HEAT PUMP COMBINATION HEATER .....	7
<b>4. DECLARATION OF CONFORMITY .....</b>	<b>8</b>
<b>5. REFERENCES .....</b>	<b>9</b>
<b>6. CONTACT DETAILS.....</b>	<b>10</b>

### III. List of Figures

FIGURE 1: DECLARED CAPACITY & COEFFICIENT OF PERFORMANCE FOR LOW TEMPERATURE APPLICATION .....	3
FIGURE 2: DECLARED CAPACITY & COEFFICIENT OF PERFORMANCE FOR MEDIUM TEMPERATURE APPLICATION.....	4
FIGURE 3: HEAT PUMP SPACE HEATER LABEL.....	6
FIGURE 4: HEAT PUMP COMBINATION HEATER LABEL .....	7
FIGURE 5: CE CERTIFICATE.....	8

## **1. Introduction**

Welcome to the Ecodesign and Energy labelling data for the Samsung Gen 5 monobloc 5kW air to water heat pump - by Joule Energy Solutions. The purpose of this document is to fulfil the requirements of the directive Eu No. 813/2013. The directive ensures the correct product information is available to BER assessors, Engineers and specifiers alike. The information within this guide is fully compliant with the directive and provides everything needed to fulfil the SEAI requirements for DEAP methodology.

Section two will cover the instruction manual & technical parameters, as outlined in; 5. REQUIREMENTS FOR PRODUCT INFORMATION, of ANNEX II, COMMISSION DELEGATED REGULATION (Eu) No 813/2013.

Section three will cover the Heat Pump product labels, as outlined in: COMMISSION DELEGATED REGULATION (Eu) No 811/2013.

*NOTE: Hot water cylinder labels & fiches are available on request- as the possible combinations can differ from project to project.*

## **2. Product information**

### **2.1. Instruction manuals**

Instruction manuals for installers and end-users are provided with each unit. However, they are also available to download from Joule's website at the following link;

<http://www.jouleuk.co.uk/wp-content/uploads/2015/10/Wiring-Diagrams-Installation-Manual1.pdf>

A copy of the installation manual will also accompany this guide.

## 2.2. Technical parameters

The following documents outline the performance results of the 5kW unit at part load conditions in low (35°) and medium (55°) temperature applications respectively.

### 2.2.1. Low temperature application

Information requirements for heat pump space heaters and heat pump combination heaters- 813/2013							
Model: Samsung AE050JXYDEH & Joule 200L H.G Cyclone							
Air-to-water heat pump: Yes							
Water-to-water heat pump: No							
Brine-to-water heat pump: No							
Low-temperature heat pump: Yes							
Equipped with a supplementary heater: Yes							
Heat Pump combination heater: Yes							
Parameters are declared for: low-temperature application							
Parameters are declared for: average climate conditions							
Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
<b>Rated heat output</b>	<i>P<sub>rated</sub></i>	5	kW	<b>Seasonal space heating energy efficiency</b>	$\eta_s$	180	%
Declared capacity for heating for part load at indoor temperature 20°C and outdoor temperature $T_j$				Declared coefficient of performance for part load at indoor temperature 20°C and outdoor temperature $T_j$			
$T_j = -7^\circ\text{C}$	<i>P<sub>dh</sub></i>	4.40	kW	$T_j = -7^\circ\text{C}$	<i>COP<sub>d</sub></i>	2.90	-
$T_j = +2^\circ\text{C}$	<i>P<sub>dh</sub></i>	2.70	kW	$T_j = +2^\circ\text{C}$	<i>COP<sub>d</sub></i>	4.41	-
$T_j = +7^\circ\text{C}$	<i>P<sub>dh</sub></i>	2.20	kW	$T_j = +7^\circ\text{C}$	<i>COP<sub>d</sub></i>	6.24	-
$T_j = +12^\circ\text{C}$	<i>P<sub>dh</sub></i>	2.20	kW	$T_j = +12^\circ\text{C}$	<i>COP<sub>d</sub></i>	6.65	-
$T_j = \text{operation limit temperature}$	<i>P<sub>dh</sub></i>	5.00	kW	$T_j = \text{operation limit temperature}$	<i>COP<sub>d</sub></i>	2.68	-
Bivalent temperature	<i>T<sub>biv</sub></i>	-10.00	°C	Operation limit temperature	TOL	-10	°C
Degradation co-efficient	<i>C<sub>dh</sub></i>	0.9	-	Heating water operating limit temperature	WTOL	55	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	<i>P<sub>OFF</sub></i>	0.08	kW	Rated heat output	<i>P<sub>SH</sub></i>	3	kW
Thermostat-off mode	<i>P<sub>TO</sub></i>	0.011	kW	Type of energy input	Electricity		
Standby mode	<i>P<sub>SB</sub></i>	0.011	kW	Outdoor sound power level			
Crankcase heater mode	<i>P<sub>CK</sub></i>	0	kW	<i>L<sub>WA</sub></i>	61	dB	
Other items				For heat pump combination heater:			
Capacity control	Variable			<b>Declared load profile</b>	L		
				Standby cylinder heat loss	2.136	kWh	
				<b>Water heating energy efficiency</b>	$\eta_{wh}$	105	%
				Reference hot water temperature	49.44	°C	
				DHW volume accounted for in test	180	L	
Contact details				Joule IE, Kylemore Park West, Ballyfermot, Dublin 10.			

Figure 1: Declared capacity & coefficient of performance for low temperature application

## 2.2.2. Medium temperature application

Information requirements for heat pump space heaters and heat pump combination heaters- 813/2013							
Model: Samsung AE05QJXYDEH & Joule 200L H.G Cyclone							
Air-to-water heat pump: Yes							
Water-to-water heat pump: No							
Brine-to-water heat pump: No							
Low-temperature heat pump: No							
Equipped with a supplementary heater: Yes							
Heat Pump combination heater: Yes							
Parameters are declared for: medium-temperature application							
Parameters are declared for: average climate conditions							
Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
<b>Rated heat output</b>	<i>Prated</i>	5	kW	<b>Seasonal space heating energy efficiency</b>	$\eta_s$	125	%
Declared capacity for heating for part load at indoor temperature 20°C and outdoor temperature $T_j$				Declared coefficient of performance for part load at indoor temperature 20°C and outdoor temperature $T_j$			
$T_j = -7^\circ\text{C}$	<i>Pdh</i>	4.20	kW	$T_j = -7^\circ\text{C}$	<i>COPd</i>	2.24	-
$T_j = +2^\circ\text{C}$	<i>Pdh</i>	2.50	kW	$T_j = +2^\circ\text{C}$	<i>COPd</i>	2.90	-
$T_j = +7^\circ\text{C}$	<i>Pdh</i>	2.20	kW	$T_j = +7^\circ\text{C}$	<i>COPd</i>	4.02	-
$T_j = +12^\circ\text{C}$	<i>Pdh</i>	2.20	kW	$T_j = +12^\circ\text{C}$	<i>COPd</i>	7.25	-
$T_j = \text{operation limit temperature}$	<i>Pdh</i>	4.70	kW	$T_j = \text{operation limit temperature}$	<i>COPd</i>	1.90	-
Bivalent temperature	<i>Tbiv</i>	-10.00	°C	Operation limit temperature	<i>TOL</i>	-10	°C
Degradation co-efficient	<i>Cdh</i>	0.9	-	Heating water operating limit temperature	<i>WTOL</i>	55	°C
Power consumption in modes other than active mode				Supplementary heater			
Off mode	<i>P<sub>OFF</sub></i>	0.08	kW	Rated heat output	<i>P<sub>sup</sub></i>	3	kW
Thermostat-off mode	<i>P<sub>TO</sub></i>	0.011	kW	Type of energy input	Electricity		
Standby mode	<i>P<sub>SB</sub></i>	0.011	kW	Outdoor sound power level	<i>L<sub>WA</sub></i>	61	dB
Crankcase heater mode	<i>P<sub>CK</sub></i>	0	kW				
Other items							
Capacity control		Variable					
For heat pump combination heater:							
<b>Declared load profile</b>		L		<b>Water heating energy efficiency</b>	$\eta_{wh}$	105	%
Standby cylinder heat loss		2.136	kWh	Reference hot water temperature		49.44	°C
				DHW volume accounted for in test		180	L
Contact details				Joule IE, Kylemore Park West, Ballyfermot, Dublin 10.			

Figure 2: Declared capacity & coefficient of performance for medium temperature application



### **3. Product labels**

This section covers the heat pump product labels, as outlined in: COMMISSION DELEGATED REGULATION (Eu) No 811/2013.

### 3.1. Heat Pump space heater

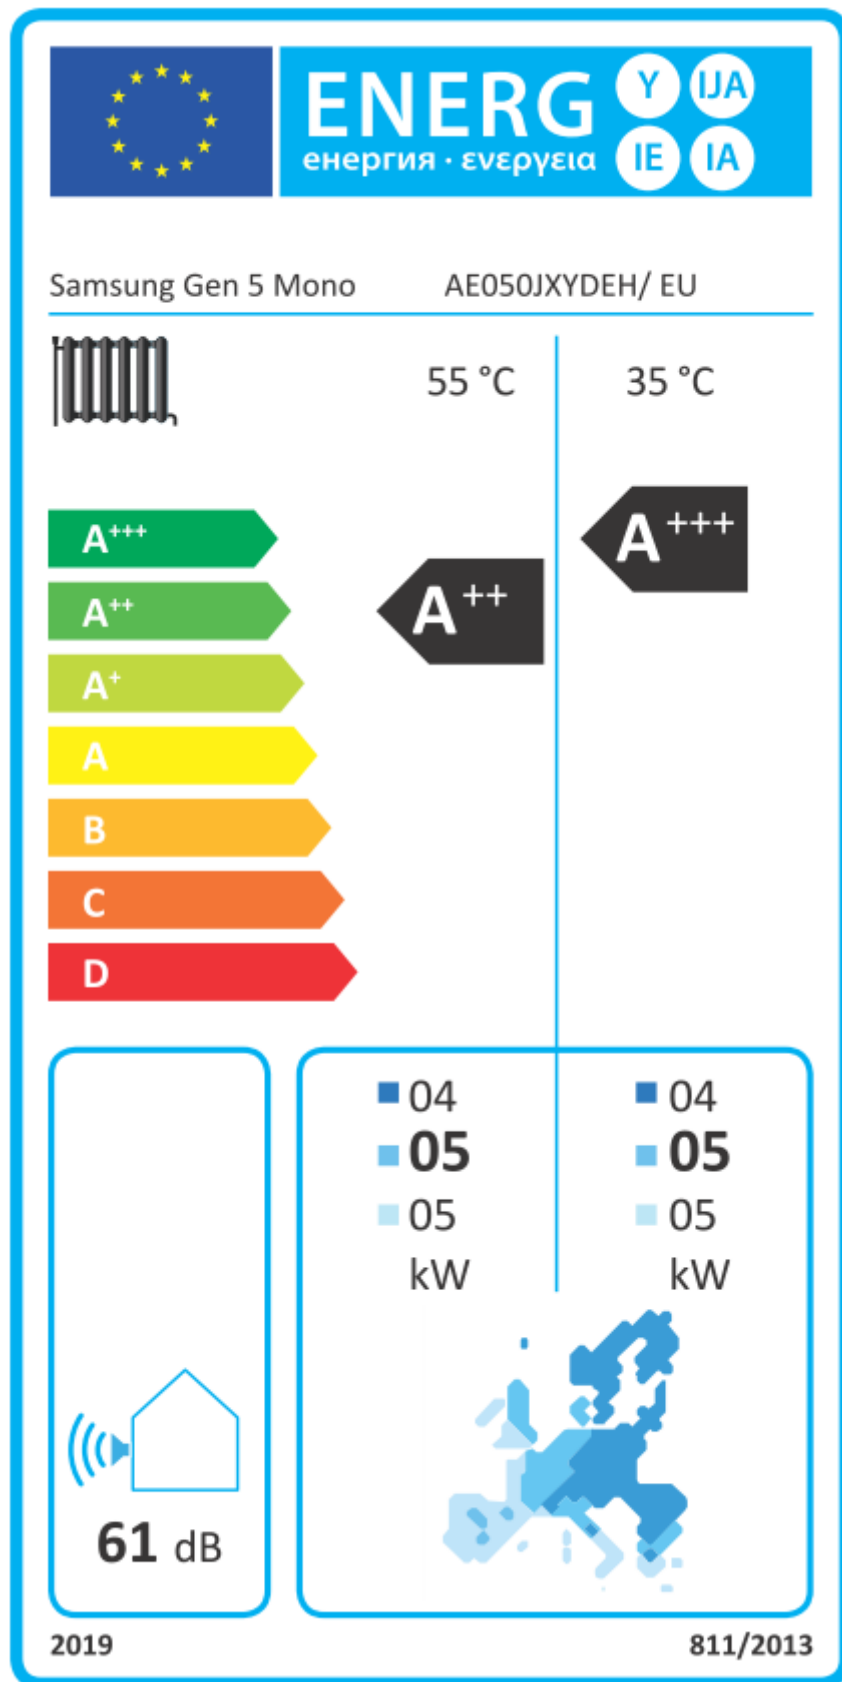


Figure 3: Heat Pump space heater label

### 3.2. Heat Pump combination heater

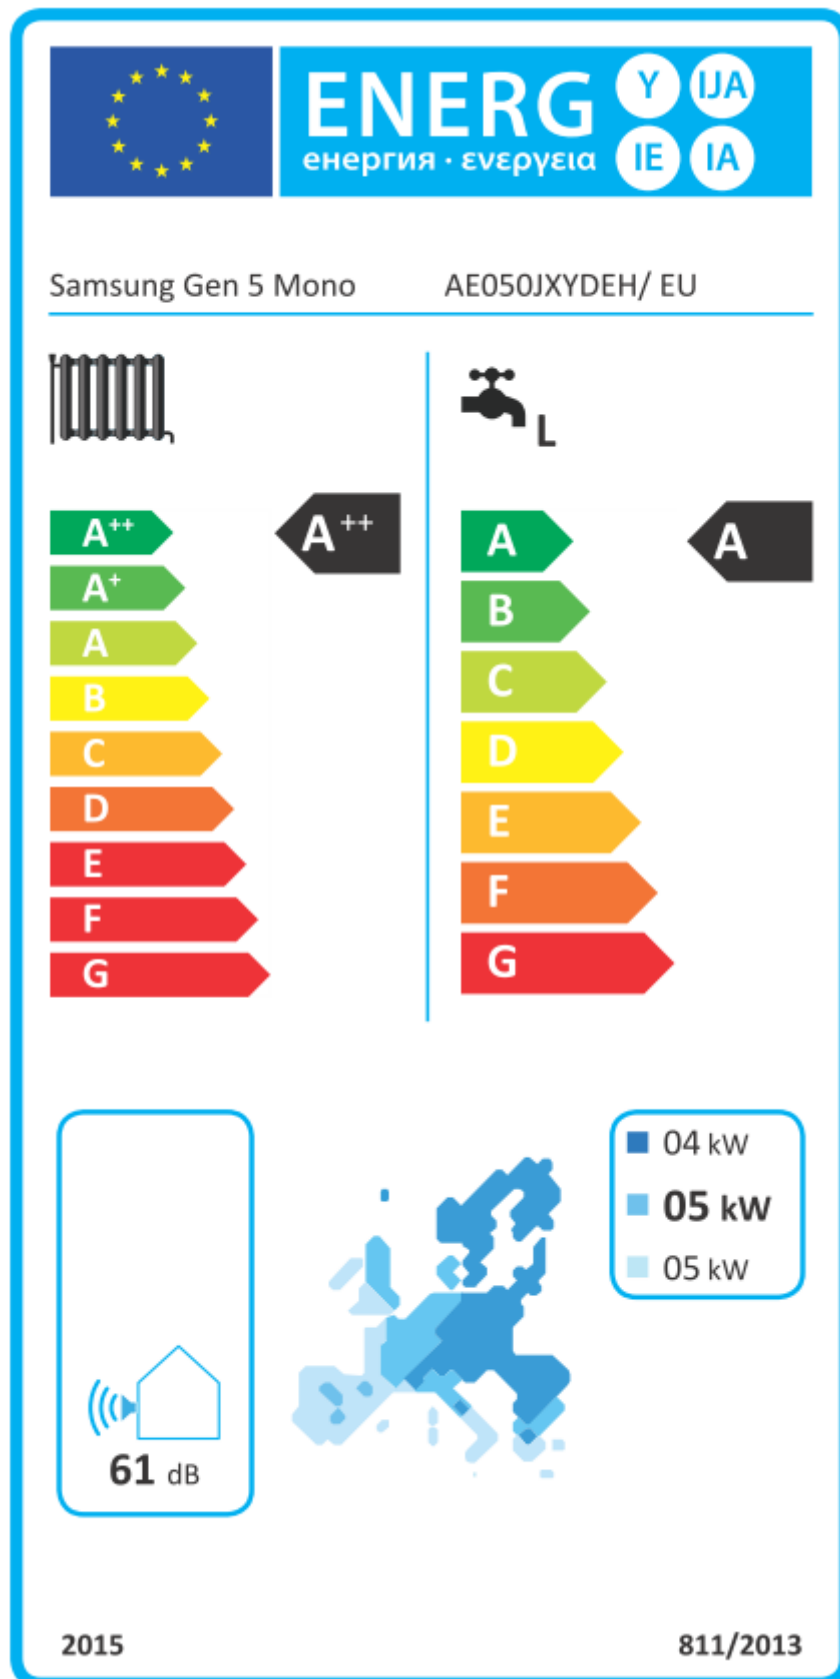


Figure 4: Heat Pump combination heater label

## 4. Declaration of Conformity

Below is the CE certificate for the 5kW monobloc unit.



### Declaration of Conformity

#### Product details

##### For the following

**Product :** Space heaters and Combination heaters

**Model(s) :** Outdoor unit(s)  
AE050JXYDEH



#### Declaration & Applicable standards

We hereby declare under our sole responsibility that the product above is in compliance with the essential requirements of the Low Voltage Directive (2006/95/EC) and the Electromagnetic Compatibility Directive (2004/108/EC) by application of:

EN 60335-1:2002 +A11:2004 +A1:2004 +A12:2006  
+A2:2006 + A13:2008 + A14:2010 +A15:2011

EN 60335-2-40:2003+A11:2004+A12:2005+A1:2006  
+A2:2009+A13:2012

EN 55014-1:2006 +A1:2009 +A2 :2011

EN 55014-2:1997 +A1:2001 +A2:2008

EN 61000-3-12:2011

EN 61000-3-11:2000

EN 62233:2008

and the Directive (2011/65/EU) on the restriction of the use of certain hazardous substances in electrical and electronic equipment by application of EN 50581:2012.

#### Representative in the EU

Samsung Electronics Euro QA Lab.  
Blackbushe Business Park  
Saxony Way, Yateley, Hampshire  
GU46 6GG, UK

Year of affixing CE marking : 2015

03 Jun. 2015

(Place and date of issue)

Stephen Colclough / EU Representative

(Name and signature of authorized person)

\* This is not the address of Samsung Service Centre. For the address or the phone number of Samsung Service Centre, see the warranty card or contact the retailer where you purchased your product.

Figure 5: CE certificate

## **5. References**

- COMMISSION DELEGATED REGULATION (Eu) No 811/2013.
- COMMISSION DELEGATED REGULATION (Eu) No 813/2013.

## 6. Contact details

Queries on any of the information in this guide can be directed to the Joule design team at: [design@joule.ie](mailto:design@joule.ie) or alternatively at (01) 623 7080.

Joule IE

Kylemore Park West,

Ballyfermot,

Dublin 10,

Ireland.

Tel: (01) 623 7080

Fax: (01) 626 9337

Web: [www.joule.ie](http://www.joule.ie)

